


The emergency operation of the EHS by hand pump presuppose that the EHS has a power failure and is without electrical voltage.

The emergency operation for all types EHS-S can be effected by means of a fixed hand pump mounted at the actuator body and for EHS-D there is a fixed hand pump or a portable hand pump. This portable hand pump has to be connected with the quick couplings K1 and K2 at the actuator.

Operating instruction is labeled on top of the pump body of the portable hand pump or fixed hand pump.

If the local indication of the actuator is not visible from the place of the hand pump (e.g. EHS-D/Q or EHS-S/Q), the end position is indicated if the pressure is between 100 and 110 bar.

An emergency operation can take place only after 2 minutes after the last remote control.

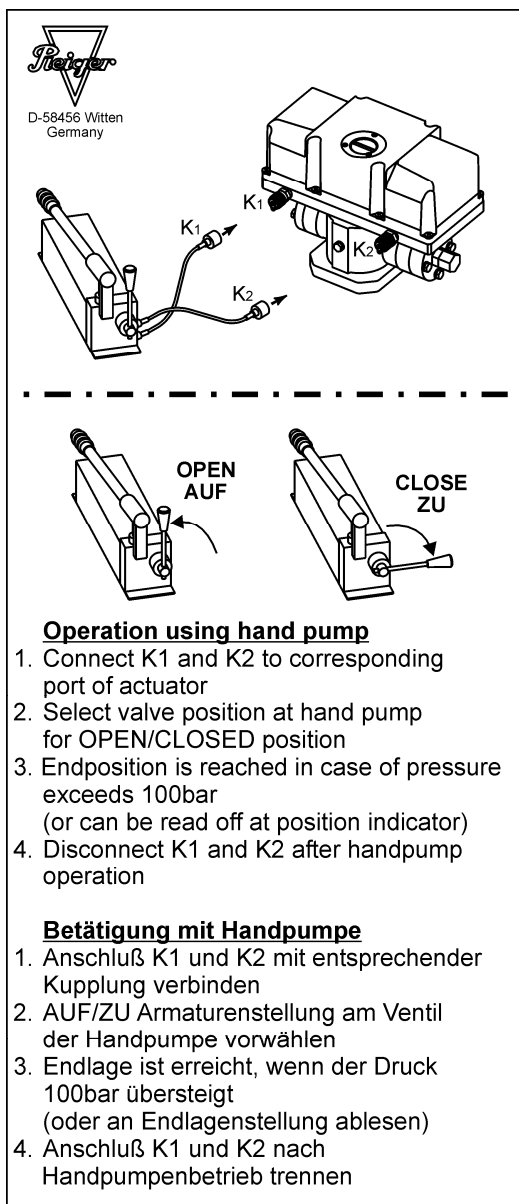

Subject to modification
Änderungen vorbehalten